



SMP7PM Supervised Power Supply/Charger

Rev. 061603

Overview:

The SMP7PM is a supervised power supply that will convert a low voltage AC input, into 12VDC or 24VDC output, with a 6 amp continuous supply current.

Specifications:

Input:

- Input 28VAC / 60Hz, 4.4 amp.

Output:

- 12VDC or 24VDC selectable output.
- 6 amp supply current.
- Filtered and electronically regulated outputs.
- Short circuit and thermal overload protection.

Battery Backup:

- Built-in charger for sealed lead acid or gel type batteries.
- Maximum charge current .7 amp.
- Zero voltage drop when switching over to battery backup.

Supervision:

- AC fail supervision (form "C" contacts).
- Battery presence and low battery supervision (form "C" contacts).

Indicators:

- AC input and DC output LED indicators.

Board Dimensions (approximate):

7"L x 4.5"W x 1.75"H

Voltage Output/Transformer Selection Table:

Output VDC	Switch Position	Max. Load DC	Transformer Requirements (Recommended Altronix Part #'s)
12VDC	SW1 Closed	6 amp	24VAC or 28VAC / 175VA (T2428175)
24VDC	SW1 Open	6 amp	24VAC or 28VAC / 175VA (T2428175)

Installation Instructions:

The SMP7PM should be installed in accordance with The National Electrical Code and all applicable Local Regulations.

1. Mount the SMP7PM in desired location/enclosure.
2. Set the SMP7PM to the desired DC output voltage by setting the switches (*Fig. 1A, pg. 2*) to the appropriate positions (*refer to Voltage Output/Transformer Selection Table*).
3. Connect proper transformer to terminals marked [AC] (*refer to Voltage Output/Transformer Selection Table*). Use 18 AWG or larger for all power connections (Battery, DC output).

Keep power limited wiring separate from non-power limited wiring (115VAC / 60Hz Input, Battery Wires). Minimum .25" spacing must be provided.

4. Measure output voltage before connecting devices. This helps avoid potential damage.
5. Connect devices to be powered to terminals marked [+ DC -].
6. When the use of stand-by batteries are desired, they must be lead acid or gel type. Connect battery to terminals marked [+ BAT -] on the board (battery leads included). Use two (2) 12VDC batteries connected in series for 24VDC operation. Note: When batteries are not used a loss of AC will result in the loss of output voltage.
7. Connect appropriate trouble reporting devices to AC Fail & Low battery supervisory relay outputs marked [N.C., C, N.O.]. Use 22 AWG to 18 AWG for AC Fail / Low Battery reporting. AC Failure will report in 5 minutes. For a 6 hour delay on reporting cut resistor R1.


LED Diagnostics:

Red (DC)	Green (AC)	Power Supply Status
ON	ON	Normal operating condition
ON	OFF	Loss of AC, Stand-by battery supplying power
OFF	ON	No DC output
OFF	OFF	Loss of AC. Discharged or no stand-by battery. No DC output

Terminal Identification:

Terminal Legend	Function/Description
AC/AC	Low voltage AC input (24VAC or 28VAC / 175VA). Altronix model # T2428175
+ DC -	12VDC / 24VDC @ 6 amp continuous output.
AC FAIL N.C., C, N.O.	Used to notify loss of AC power, (e.g. connect to audible device or alarm panel). Relay normally energized when AC power is present. Contact rating 1 amp @ 28VDC
Low Battery N.C., C, N.O.	Used to indicate low battery condition, (e.g. connect to alarm panel). Relay normally energized when DC power is present. Contact rating 1 amp @ 28VDC
+ BAT -	Stand-by battery connections. Maximum charge rate 1.25 amp.

Fig. 1

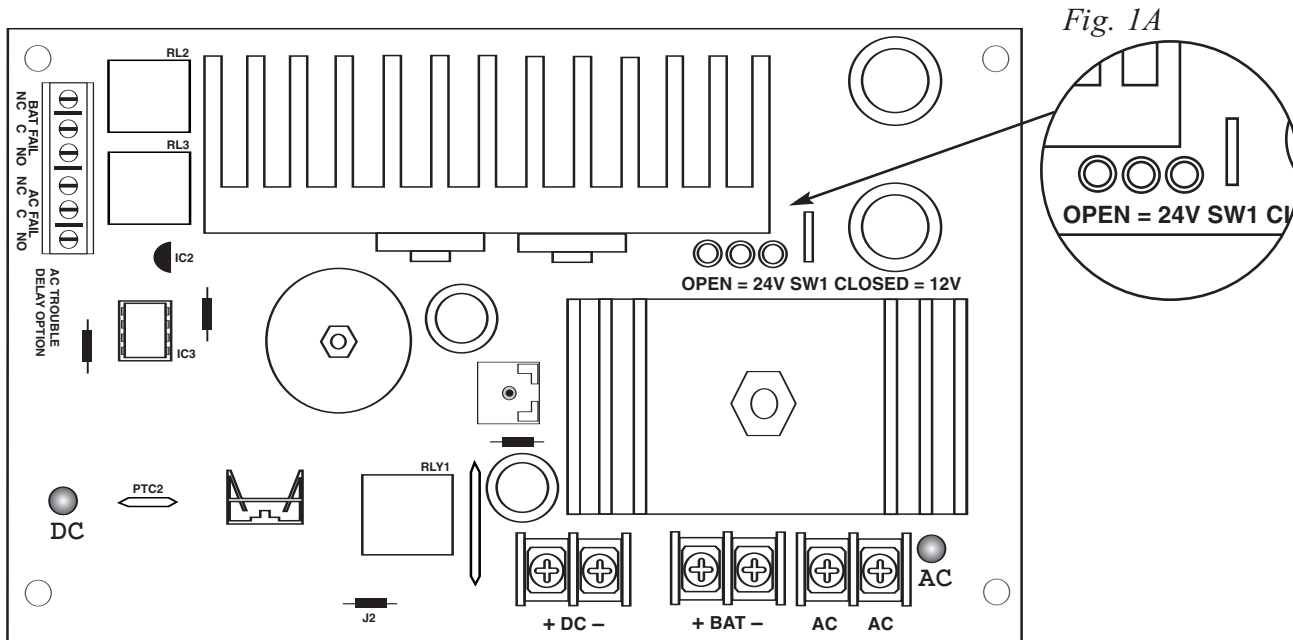

Altronix is not responsible for any typographical errors. Product specifications are subject to change without notice.

