

WFDTH Waterflow Detector



Models Available

WFDTH	Waterflow Detector
WFDTHA	Waterflow Detector (ULC/Canadian)

Replacement Parts

A77-01-02	Terminal Block
A3008-00	Retard Mechanism
PRK9	Paddle Kit
S07-66-02	Tamper Screws for Cover
WFDW	Tamper Proof Wrench for Cover
C58-0009-000	Metal Cover

WFDTH Waterflow Detector



Product Overview

Designed for use in residential sprinkler systems

Sealed Retard mechanism (Model WFDTH) assures that the retard is not contaminated by dust and dirt when the cover is removed

Visual switch activation permits installer to accurately set the retard even under extremely noisy conditions

Rugged, dual SPDT switches are enclosed in a durable terminal block for added strength

Accommodates up to 12 AWG wire

100% synchronization fires both alarm panel and local bell simultaneously

The System Sensor WFDTH Retard T-Tap Waterflow Detector is designed for primary signaling in residential systems and fits within 2x4 stud wall construction. The model fits any tee that has a 1" NPT branch, including: 1", 1¹/₄", 1¹/₂", and 2" NPT threaded ferrous and brass tees; 1", 1¹/₄", 1¹/₂" and 2" copper sweat tees; Central, Spears®, and Victaulic® brand 1" CPVC tees; and 1¹/₂" polybutylene tees.

Design. The design of the WFDTH makes it easy to install and simple to maintain. It can be mounted in the vertical or horizontal position. Two conduit openings permit easy attachment to the local alarm system. The retard mechanism and switch assembly are field-replaceable.

Features. Twelve different flexible paddles fit 1", 1¹/₄", 1¹/₂", and 2" tees. Sizes are marked clearly on the paddle for ease of installation. Plastic paddles slip over the actuating lever and are securely fastened with one screw. The handy depth gauge insures the proper installation depth and clearance of the detector to the tee.

Construction. The WFDTH includes a durable and tamper resistant enclosure. Its sealed retard assures that the delay mechanism is not contaminated by dust and dirt when the cover is removed. The long lasting cover completely encloses the electrical components to further keep out dust and dirt. Improved self-guiding security screws and removal tools make detectors resistant to tampering and simplify field maintenance.



S739



CS169




167-93-E

Engineering Specifications

Model shall be a WFDTH as manufactured by System Sensor. T-tap waterflow detectors shall be installed on a tee that has a 1" NPT branch including: 1", 1¼", 1½", or 2" threaded ferrous or brass tee; 1–2" copper sweat tees; Central, Spears®, and Victaulic® brand 1" CPVC tees; or 1½" polybutylene tee as designated on the drawings and/or as specified herein. Detectors shall mount on any clear pipe span of the appropriate size, either a vertical or horizontal run at least 6" from any fittings or valves which may change water direction, flow rate, or pipe diameter or no closer than 24" from a valve or drain. Detectors shall have a sensitivity in the range of 4 to 10 gallons per minute and a static pressure rating of 250 psi. The retard t-tap detector shall be a sealed mechanical pneumatic unit with visual indication of actuation. The actuation mechanism shall include a polyethylene vane inserted through the tee fitting and connected by a mechanical linkage to the delay mechanism. Outputs shall consist of dual SPDT switches (Form C contacts). Two conduit entrances (one of which is a knockout type) for standard fittings of commonly used electrical conduit shall be provided on the detectors. A grounding provision is provided. WFDTH is listed by Underwriters Laboratories for indoor use.

Electrical Connections

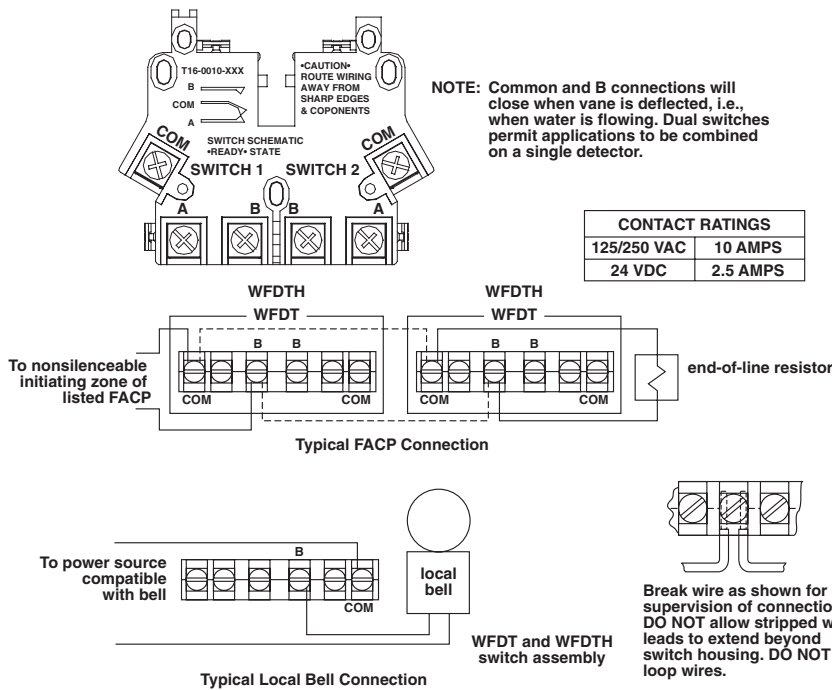

Ordering Information

Part Number	Description
WFDTH*	Waterflow Detector, Fits 1", 1¼", 1½", 2" ferrous and brass threaded tees; 1", 1¼", 1½", 2" copper sweat tees; 1" CPVC tees; and 1½" polybutylene tees
A77-01-02	Replacement Terminal Block for WFDTH
A3008-00	Replacement Retard Mechanism
PRK9	Replacement Paddle Kit — 12 paddles for WFDTH (see WFDTH for sizes included)
S07-66-02	Replacement Tamper Screws for Covers of WFDTH
WFDW	Replacement Tamper Proof Wrench for Cover of WFDTH
C58-0009-000	Replacement Metal Cover

*ULC version designated with "A" suffix (WFDTHA).

System Sensor Sales and Service

System Sensor Headquarters
3825 Ohio Avenue
St. Charles, IL 60174
Ph: 800/SENSOR2
Fx: 630/377-6495
www.systemsensor.com

System Sensor Canada
Ph: 905.812.0767
Fx: 905.812.0771

System Sensor Europe
Ph: 44.1403.891920
Fx: 44.1403.891921

System Sensor in China
Ph: 86.29.8832.0119
Fx: 86.29.8832.5119

System Sensor in Singapore
Ph: 65.6273.2230
Fx: 65.6273.2610

System Sensor – Far East
Ph: 85.22.191.9003
Fx: 85.22.736.6580

System Sensor – Australia
Ph: 613.54.281.142
Fx: 613.54.281.172

System Sensor – India
Ph: 91.124.237.1770 x.2700
Fx: 91.124.237.3118

System Sensor – Russia
Ph: 70.95.937.7982
Fx: 70.95.937.7983

©2005 System Sensor. The company reserves the right to change product specifications without notice. Spears® is a registered trademark of the Spears Manufacturing Company. Victaulic® is a registered trademark of the Victaulic Company of America.

A05-0941-006•6/05•#1466

Standard Specifications

Static Pressure Rating

250 PSI (max.)

Triggering Threshold Bandwidth (Flow Rate)

4 to 10 GPM

Maximum Surge

18 FPS

Compatible Tee Fittings

Threaded ferrous and brass tees, copper sweat tees, CPVC tees, and polybutylene tees

Contact Ratings

2 sets of SPDT (Form C)

10.0 A @ 125/250 VAC

2.5 A @ 24 VDC

Overall Dimensions, Installed

4.5" H x 3.55" W x 6.7" L
(11.4cm H x 9cm W x 17cm L)

Conduit Entrances

Two openings for ½" conduit

Operating Temperature Ranges

32°F – 120°F (0°C – 49°C)

Cover Tamper Switch

Canadian models only, factory installed

Enclosure

UL listed for indoor use

Shipping Weight

2.6 lbs.

Service Use

Automatic Sprinkler:

NFPA 13

One or Two Family Dwelling:

NFPA 13D

Residential Occupancies up to 4 Stories:

NFPA 13R

National Fire Alarm Code:

NFPA 72

Warranty

3 years


U.S. Patent Numbers

3,845,259

4,782,333

5,213,205

Delay Adjustment Dial

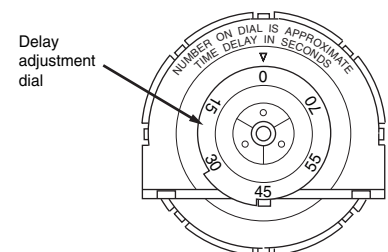

NOTE: Retard time may exceed 90 seconds. Adjust and verify that time does not exceed 90 seconds.